




RADIANT LAYOL

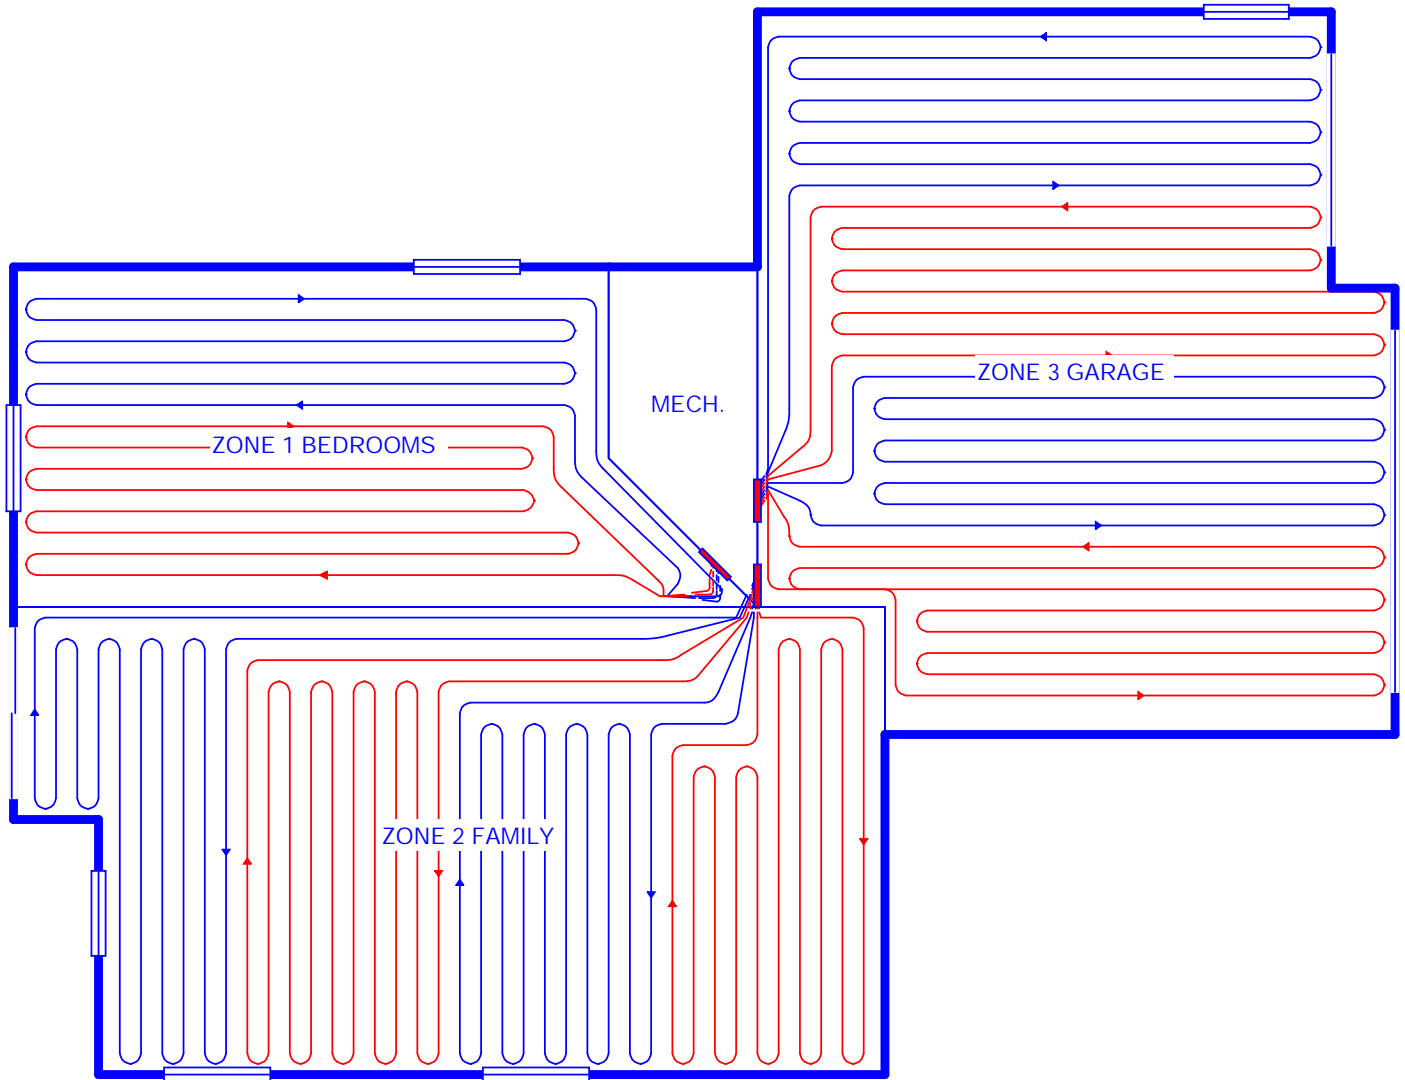

Job #: SAMPLE
Performed for:
SAMPLE RESIDENCE

HPS CONTROLS LTD.

10683 214 ST
EDMONTON, AB T5S2A2
Phone: 780-482-1051 Fax: 780-482-3143
CURTIS.HPS@TELUS.NET

Scale: 1 : 108

Page 1
Right-Suite@ Universal
8.0.11 RSU08414
2011-Jun-29 13:04:26

...\\Wrightsoft HVAC\HARTMAN RES...